

〇〇〇〇〇〇〇〇〇〇〇〇〇〇

〇〇〇〇〇〇

〇〇〇〇〇〇〇〇〇


〇〇〇〇〇〇〇〇〇〇〇〇

〇〇〇〇〇〇〇〇〇〇〇〇 〇 〇

- 〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇

〇〇〇〇〇〇〇 5m 〇.2 〇〇〇〇〇〇〇〇〇 〇.3 〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇 4m 〇〇〇〇 〇.3 〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇〇
〇.24 〇〇〇〇

Image

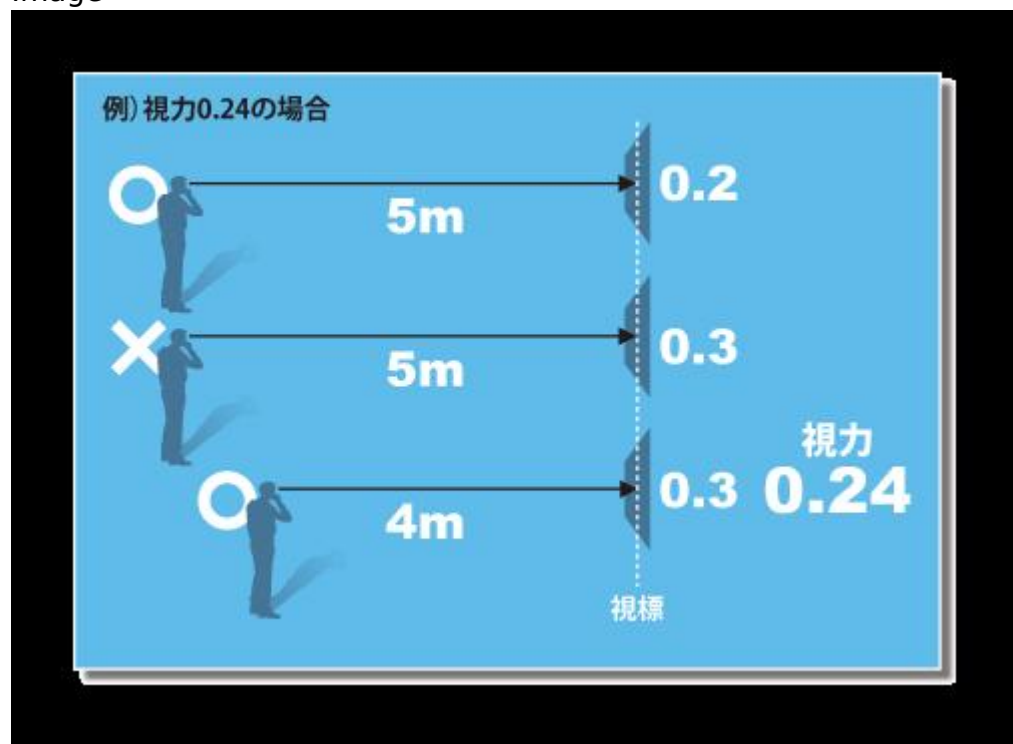

- □□□□□□□□□□□□□□□□□□□□

□□□□□□

Image

測定距離 5m	測定距離	視標	詳細な視力 (理論値)
0.1	1m	0.1	(0.02)
0.2	1.5m		(0.03)
0.3	2m		(0.04)
0.4	2.5m		(0.05)
0.5	3m		(0.06)
0.6	4m		(0.08)
0.7	3m	0.2	(0.12)
0.8	4m		(0.16)
0.9	4m	0.3	(0.24)
1.0			
1.2			
1.5			
2.0			

□□□□□□□□□□□□

Image



□□□□□□□□□□□□□□□□

□□□□□□

Source URL: <https://www.pro.novartis.com/jp-ja/products/lucentis/patienttool>